




V=

HV


LV  
~12Vac  
HV  
~100Vac

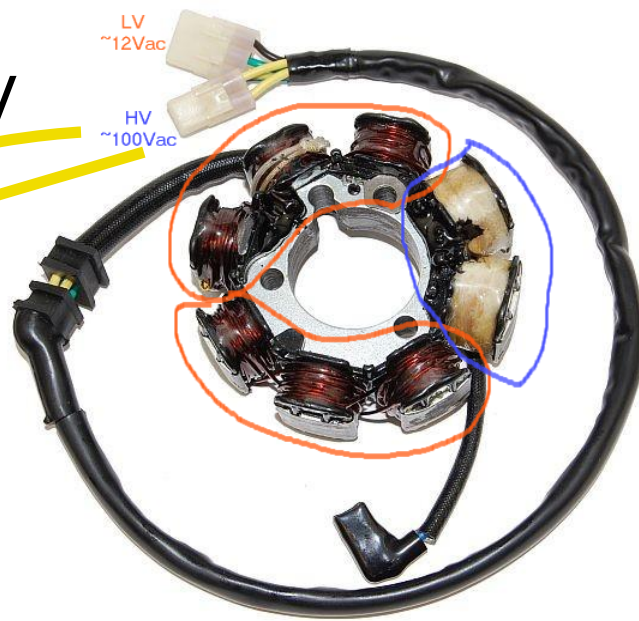


NOT internally connected to Ground

HV


LV  
~12Vac  
HV  
~100Vac

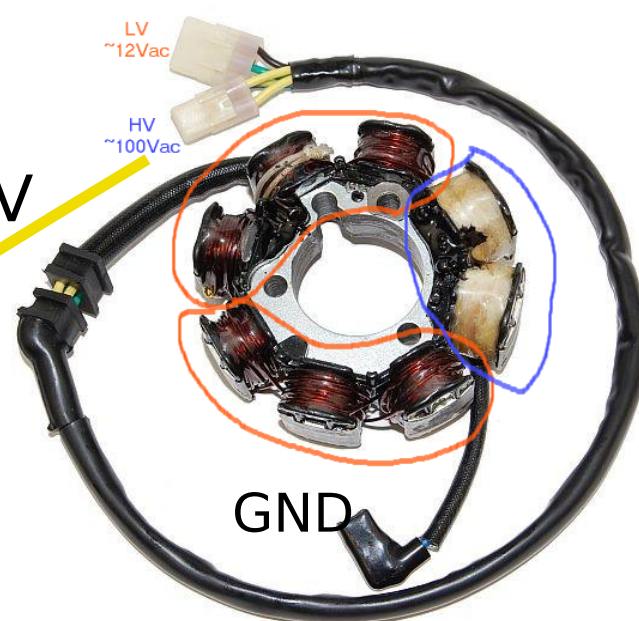

internally connected to Ground

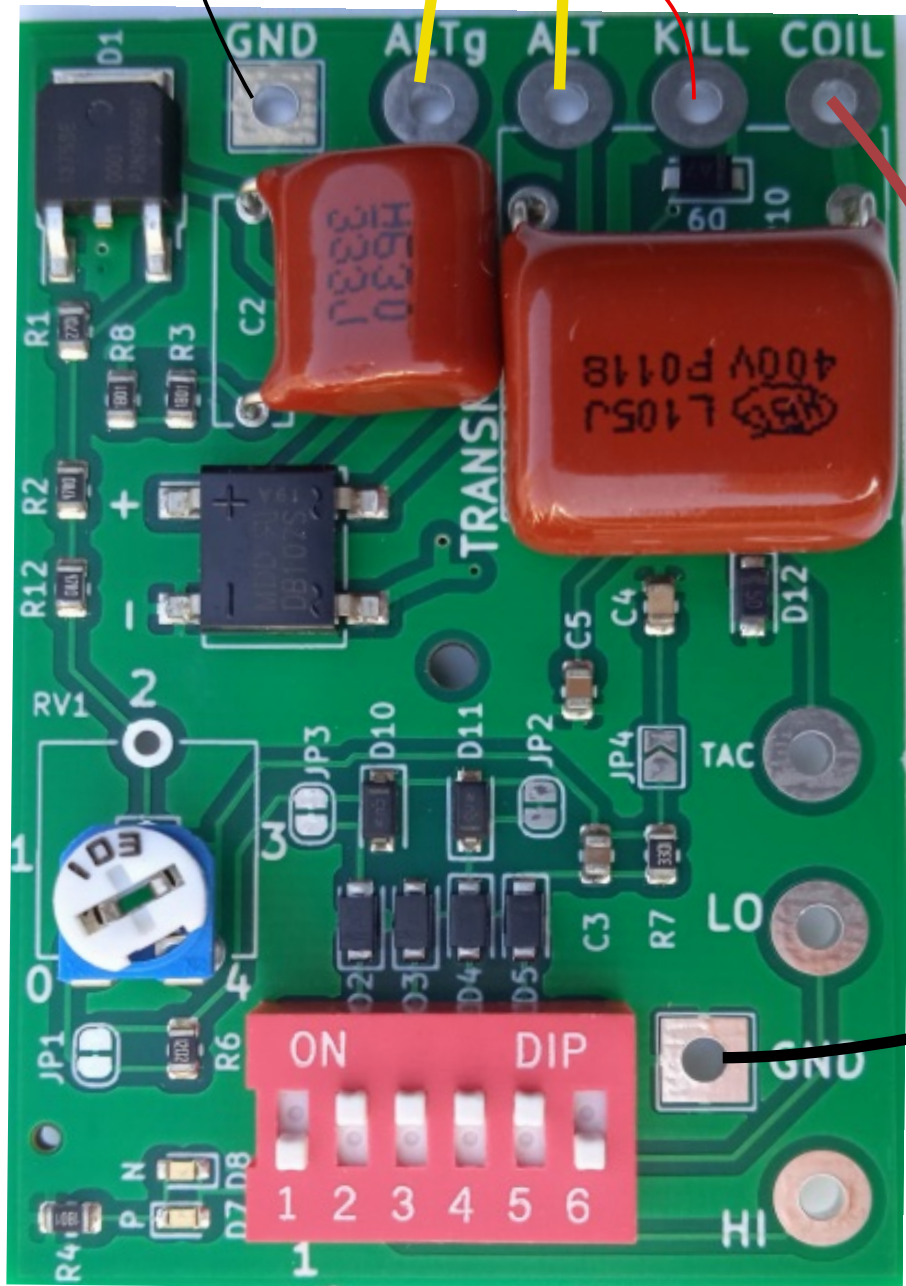

GND

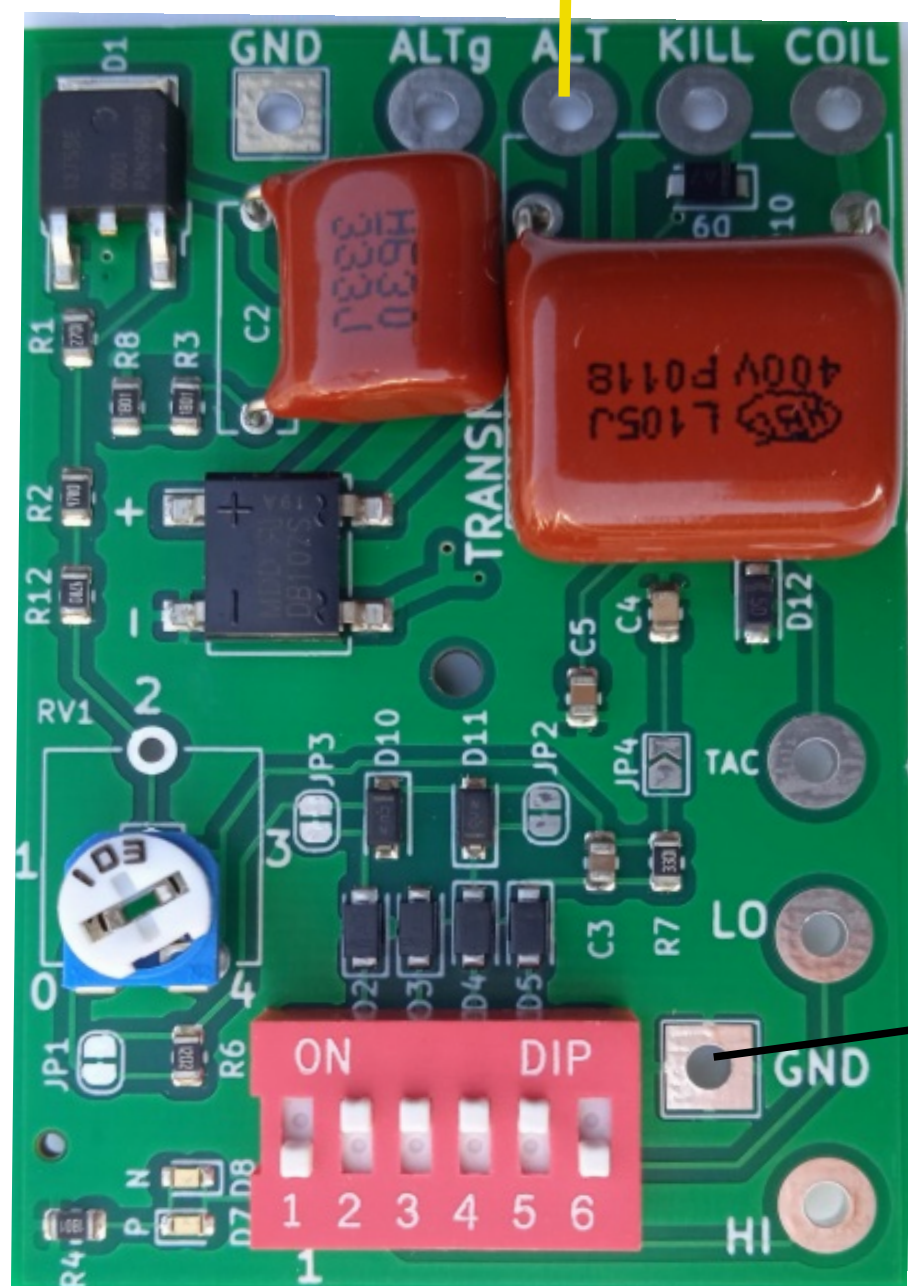

GND